


SIDEWALK SECTION

1/2" x 18" smooth bars @ 24" o.c. in sidewalk, one each in curb and gutter one end to be sleeved or greased.

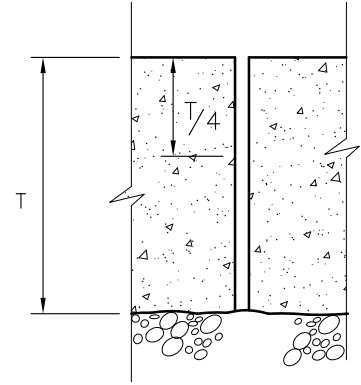


All cuts to be made with with an abrasive-type cutting wheel.

Remaining edge to be smooth and true with no shatter.

Depth of cut= $T/4$, 1 1/2" min.

CUT DETAIL

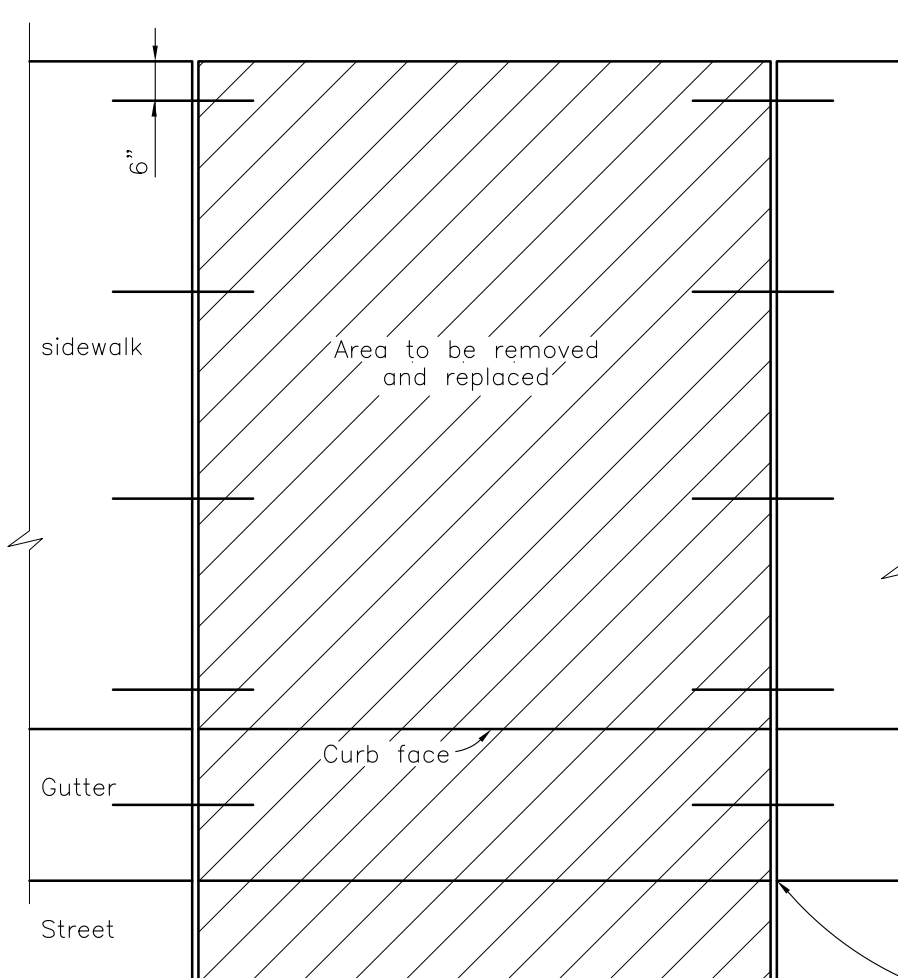

PLAN OF CURB, GUTTER & SIDEWALK

NOTE: Complete section of curb shall be removed.

Extents of sidewalk removal and restoration shall conform to the provisions of Section 19 of the Standard Specifications.

See Engineering Standard #4110 for notes regarding required pavement removal & repair.

REVISIONS	BY	APP	DATE
New border	JDL	WAP	9-97
Removal Extents Rev.	BL	JDW	10-03
Revise re-bar specs	JDL	WAP	11-98
STANDARD CURRENT AS OF:		January 2010	



CUTTING CONCRETE